

2008 Wastewater Reuse Conference

Barry N. Burnell
Water Quality Division
Administrator
June 17 - 18, 2008

The Water Report -- May 15, 2008

Water Reuse Planning – Graphical Tools to Clarify Decisions: A Water Reuse Case Study


By

- Dr. John Scott Thomas, Ph.D. Senior Scientist – Stetson Engineers, INC. (Diamondhead MS) San Rafael, CA
- 228-342-0239
- scottt@stetsonengineers.com

High

Consistency and Conservation Value

Consistent
Variable
Consistency of Demand

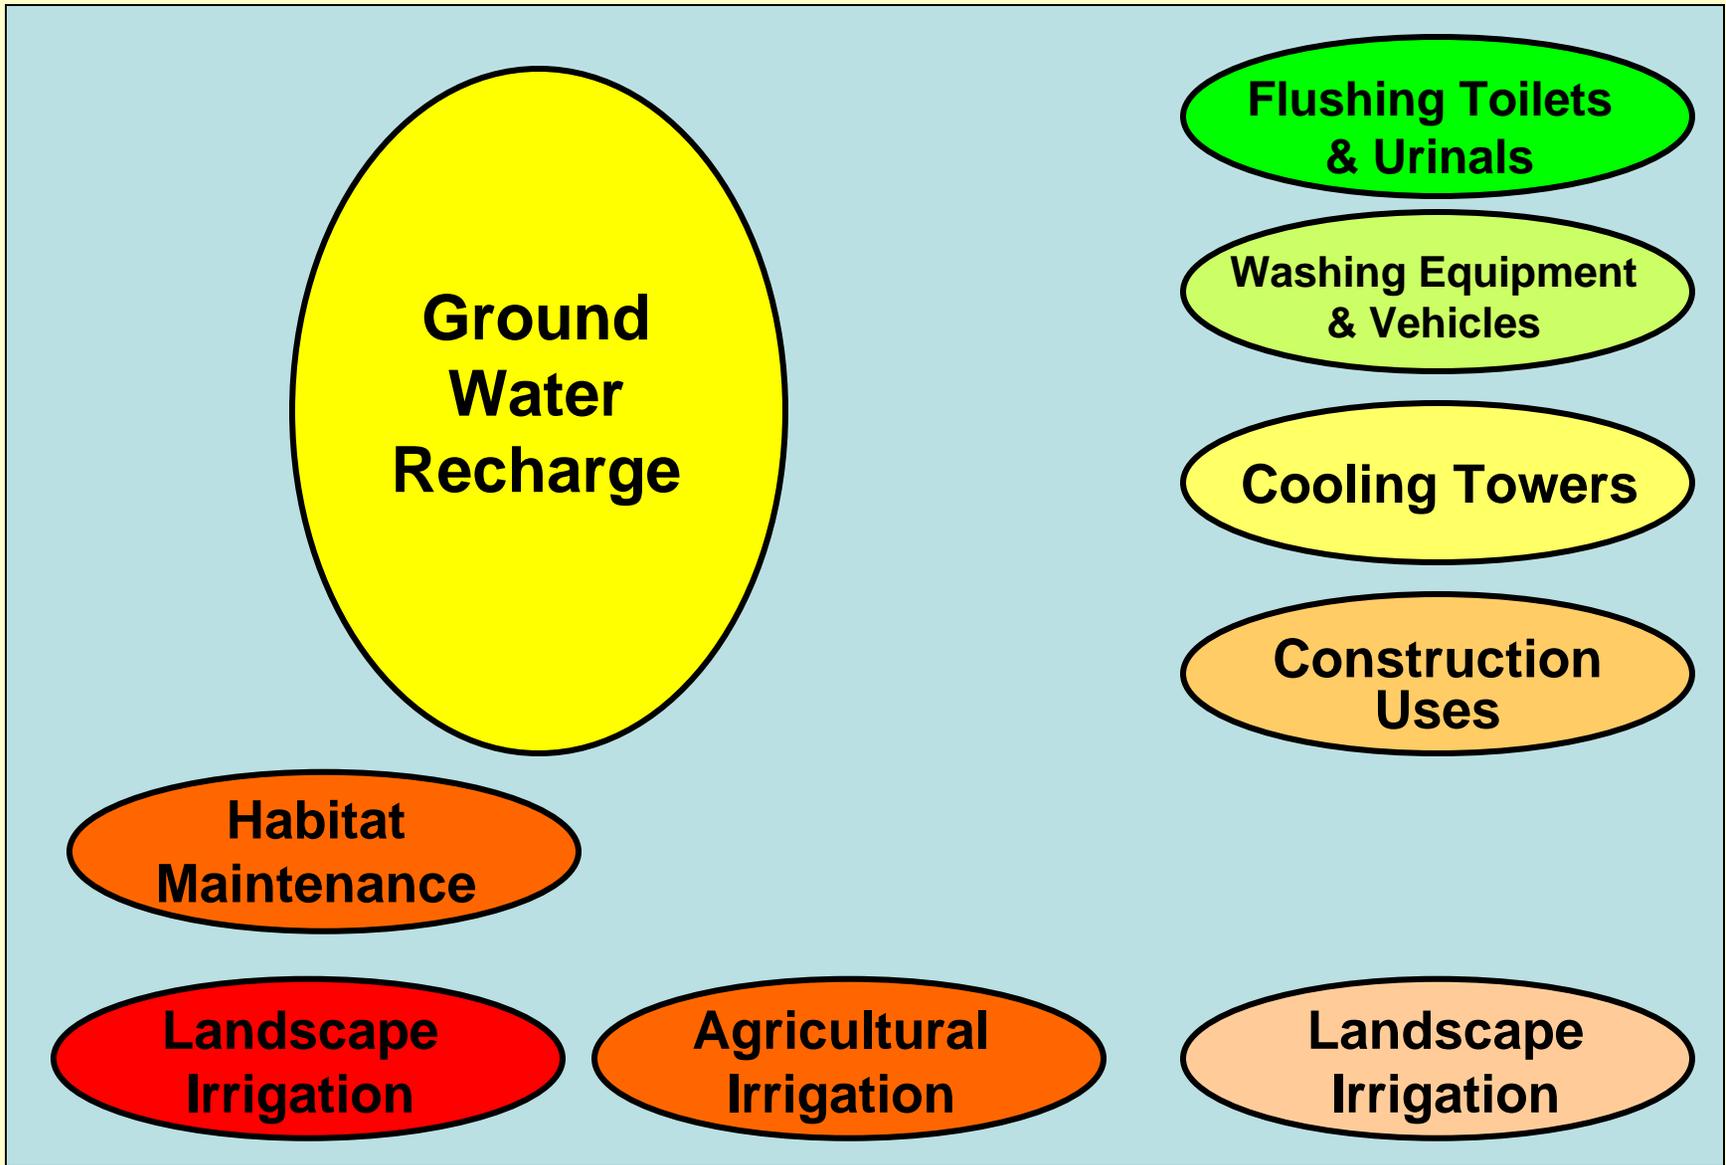

New Use

Sub for Untreated Water

Sub for Potable Water


Low

Water Conservation Value

High

High

Ease of Implementability

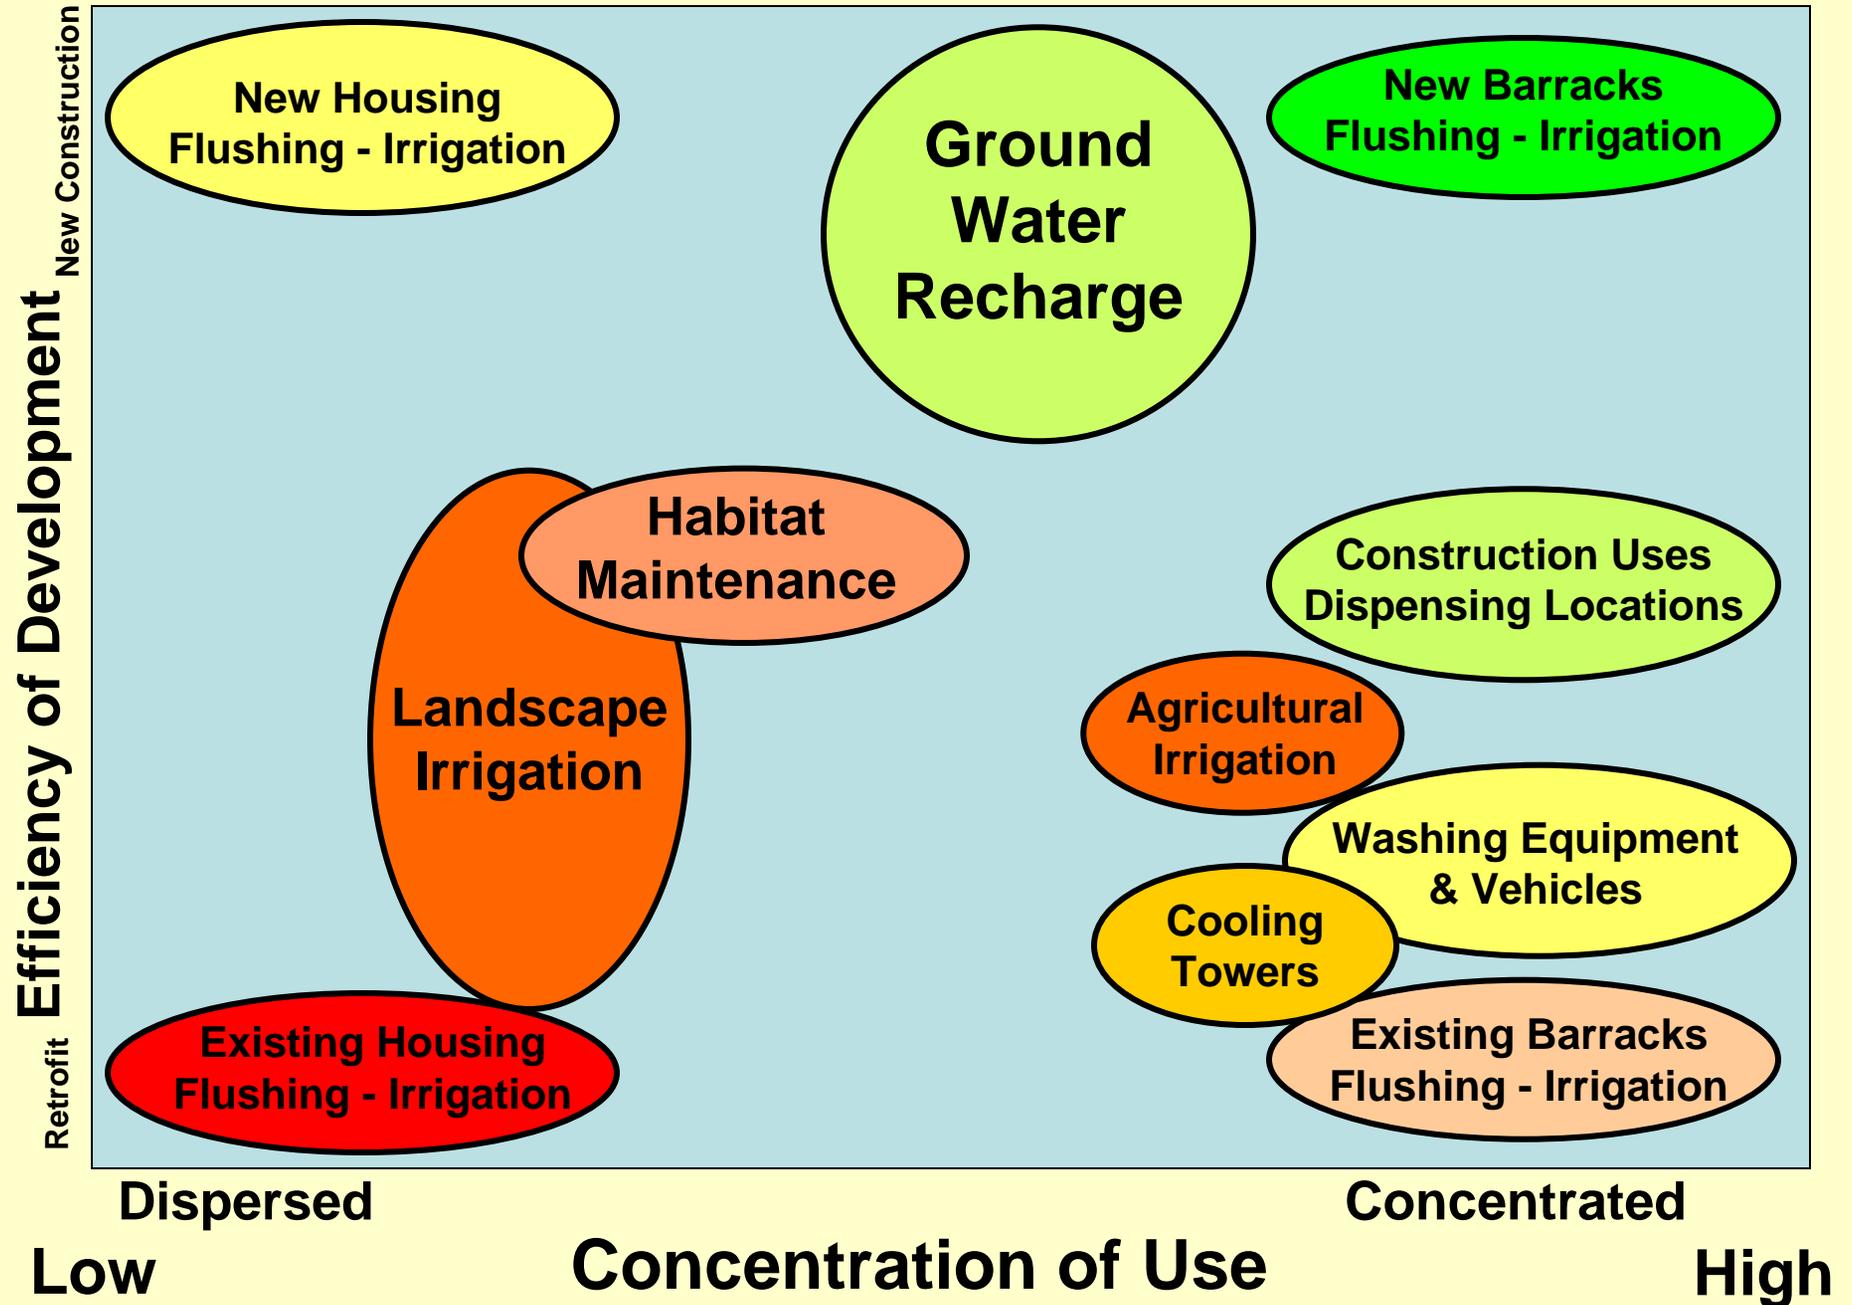

Low

Concentration of Use

High

Barry N. Burnell
Water Quality Division Administrator
Idaho Department of Environmental Quality
1410 N. Hilton
Boise, ID 83706

Phone: 208-373-0194
FAX: 208-373-0576
E-mail: barry.burnell@deq.idaho.gov
Website: <http://www.deq.idaho.gov/>
